

REFERENCE: W-5206AG

PROJECT: 45336.1.FR33

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS
GEOTECHNICAL ENGINEERING UNIT

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	45336.1.FR33	1	9

CONTENTS

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
1	TITLE SHEET
2	LEGEND
3 - 4	SITE PLAN & PROFILES
5 - 8	BORE LOG(S)
9	SOIL TEST RESULTS

STRUCTURE
SUBSURFACE INVESTIGATION

COUNTY HARNETT
PROJECT DESCRIPTION CAMPBELL UNIVERSITY
PEDESTRIAN TUNNEL UNDER US-421 /NC-27
IN BUIES CREEK
SITE DESCRIPTION _____
RETAINING WALL -RW1- STA 10+00 TO STA 11+29.42
RETAINING WALL -RW3- STA 10+00 TO STA 11+59.16
RETAINING WALL -RW4- STA 10+00 TO STA 10+49.29
RETAINING WALL -RW5- STA 10+13.87 TO STA 11+36.52

CAUTION NOTICE

THE SUBSURFACE INFORMATION AND THE SUBSURFACE INVESTIGATION ON WHICH IT IS BASED WERE MADE FOR THE PURPOSE OF STUDY, PLANNING AND DESIGN, AND NOT FOR CONSTRUCTION OR PAY PURPOSES. THE VARIOUS FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA AVAILABLE MAY BE REVIEWED OR INSPECTED IN RALEIGH BY CONTACTING THE N. C. DEPARTMENT OF TRANSPORTATION, GEOTECHNICAL ENGINEERING UNIT AT (919) 707-6850. THE SUBSURFACE PLANS AND REPORTS, FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA ARE NOT PART OF THE CONTRACT.

GENERAL SOIL AND ROCK STRATA DESCRIPTIONS AND INDICATED BOUNDARIES ARE BASED ON A GEOTECHNICAL INTERPRETATION OF ALL AVAILABLE SUBSURFACE DATA AND MAY NOT NECESSARILY REFLECT THE ACTUAL SUBSURFACE CONDITIONS BETWEEN BORINGS OR BETWEEN SAMPLED STRATA WITHIN THE BOREHOLE. THE LABORATORY SAMPLE DATA AND THE IN SITU (IN-PLACE) TEST DATA CAN BE RELIED ON ONLY TO THE DEGREE OF RELIABILITY INHERENT IN THE STANDARD TEST METHOD. THE OBSERVED WATER LEVELS OR SOIL MOISTURE CONDITIONS INDICATED IN THE SUBSURFACE INVESTIGATIONS ARE AS RECORDED AT THE TIME OF THE INVESTIGATION. THESE WATER LEVELS OR SOIL MOISTURE CONDITIONS MAY VARY CONSIDERABLY WITH TIME ACCORDING TO CLIMATIC CONDITIONS INCLUDING TEMPERATURES, PRECIPITATION AND WIND, AS WELL AS OTHER NON-CLIMATIC FACTORS.

THE BIDDER OR CONTRACTOR IS CAUTIONED THAT DETAILS SHOWN ON THE SUBSURFACE PLANS ARE PRELIMINARY ONLY AND IN MANY CASES THE FINAL DESIGN DETAILS ARE DIFFERENT. FOR BIDDING AND CONSTRUCTION PURPOSES, REFER TO THE CONSTRUCTION PLANS AND DOCUMENTS FOR FINAL DESIGN INFORMATION ON THIS PROJECT. THE DEPARTMENT DOES NOT WARRANT OR GUARANTEE THE SUFFICIENCY OR ACCURACY OF THE INVESTIGATION MADE, NOR THE INTERPRETATIONS MADE, OR OPINION OF THE DEPARTMENT AS TO THE TYPE OF MATERIALS AND CONDITIONS TO BE ENCOUNTERED. THE BIDDER OR CONTRACTOR IS CAUTIONED TO MAKE SUCH INDEPENDENT SUBSURFACE INVESTIGATIONS AS HE DEEMS NECESSARY TO SATISFY HIMSELF AS TO CONDITIONS TO BE ENCOUNTERED ON THE PROJECT. THE CONTRACTOR SHALL HAVE NO CLAIM FOR ADDITIONAL COMPENSATION OR FOR AN EXTENSION OF TIME FOR ANY REASON RESULTING FROM THE ACTUAL CONDITIONS ENCOUNTERED AT THE SITE DIFFERING FROM THOSE INDICATED IN THE SUBSURFACE INFORMATION.

- NOTES:
1. THE INFORMATION CONTAINED HEREIN IS NOT IMPLIED OR GUARANTEED BY THE N. C. DEPARTMENT OF TRANSPORTATION AS ACCURATE NOR IS IT CONSIDERED PART OF THE PLANS, SPECIFICATIONS OR CONTRACT FOR THE PROJECT.
 2. BY HAVING REQUESTED THIS INFORMATION, THE CONTRACTOR SPECIFICALLY WAIVES ANY CLAIMS FOR INCREASED COMPENSATION OR EXTENSION OF TIME BASED ON DIFFERENCES BETWEEN THE CONDITIONS INDICATED HEREIN AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

PERSONNEL

F. WRIGHT

A. RIGGS JR.

M.B. MOSELEY

M.G. MOSELEY

J. WHITE

T.J. WILLIAMS

INVESTIGATED BY S&ME, INC.

DRAWN BY B. RATTI

CHECKED BY A.F. RIGGS, JR P.E.

SUBMITTED BY S&ME, INC.

DATE DECEMBER 2014

SIGNATURE

DATE

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS
GEOTECHNICAL ENGINEERING UNIT
SUBSURFACE INVESTIGATION
SOIL AND ROCK LEGEND, TERMS, SYMBOLS, AND ABBREVIATIONS

SOIL DESCRIPTION

SOIL IS CONSIDERED UNCONSOLIDATED, SEMI-CONSOLIDATED, OR WEATHERED EARTH MATERIALS THAT CAN BE PENETRATED WITH A CONTINUOUS FLIGHT POWER AUGER AND YIELD LESS THAN 100 BLOWS PER FOOT ACCORDING TO THE STANDARD PENETRATION TEST (AASHTO T 206, ASTM D1586). SOIL CLASSIFICATION IS BASED ON THE AASHTO SYSTEM. BASIC DESCRIPTIONS GENERALLY INCLUDE THE FOLLOWING: CONSISTENCY, COLOR, TEXTURE, MOISTURE, AASHTO CLASSIFICATION, AND OTHER PERTINENT FACTORS SUCH AS MINERALOGICAL COMPOSITION, ANGULARITY, STRUCTURE, PLASTICITY, ETC. FOR EXAMPLE, *VERY STIFF, GRAY, SILTY CLAY, MOIST WITH INTERBEDDED FINE SAND LAYERS, HIGHLY PLASTIC, A-7-6*

SOIL LEGEND AND AASHTO CLASSIFICATION

GENERAL CLASS.	GRANULAR MATERIALS (≤ 35% PASSING #200)							SILT-CLAY MATERIALS (> 35% PASSING #200)			ORGANIC MATERIALS					
	A-1	A-3	A-2	A-2-4	A-2-5	A-2-6	A-2-7	A-4	A-5	A-6	A-7	A-1, A-2	A-3	A-4, A-5	A-6, A-7	
GROUP CLASS.	A-1-a	A-1-b	A-2-4	A-2-5	A-2-6	A-2-7					A-7-5, A-7-6					
SYMBOL																
% PASSING #10 #40 #200	50 MX 30 MX 15 MX	50 MX 25 MX	51 MN 10 MX	35 MX	35 MX	35 MX	35 MX	36 MN	36 MN	36 MN	36 MN	36 MN				
MATERIAL PASSING #40 LL PI	- 6 MX	- NP	40 MX 10 MX	41 MN 10 MX	40 MX 11 MN	41 MN 11 MN	40 MX 10 MX	41 MN 10 MX	40 MX 11 MN	41 MN 11 MN						
GROUP INDEX	0	0	0	4 MX			8 MX	12 MX	16 MX	NO MX						
USUAL TYPES OF MAJOR MATERIALS	STONE FRAGS. GRAVEL, AND SAND	FINE SAND	SILTY OR CLAYEY GRAVEL AND SAND				SILTY SOILS			CLAYEY SOILS						
GEN. RATING AS SUBGRADE	EXCELLENT TO GOOD			FAIR TO POOR			FAIR TO POOR	POOR	UNSATURABLE							
	PI OF A-7-5 SUBGROUP IS ≤ LL - 30 ; PI OF A-7-6 SUBGROUP IS > LL - 30															

CONSISTENCY OR DENSENESS

PRIMARY SOIL TYPE	COMPACTNESS OR CONSISTENCY	RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)	RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT ²)
GENERALLY GRANULAR MATERIAL (NON-COHESIVE)	VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE	< 4 4 TO 10 10 TO 30 30 TO 50 > 50	N/A
GENERALLY SILT-CLAY MATERIAL (COHESIVE)	VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD	< 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 > 30	< 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 > 4

TEXTURE OR GRAIN SIZE

U.S. STD. SIEVE SIZE OPENING (MM)	4	10	40	60	200	270
	4.76	2.00	0.42	0.25	0.075	0.053
BOULDER (BLDR.)						
COBBLE (COB.)						
GRAVEL (GR.)						
COARSE SAND (CS.E. SD.)						
FINE SAND (F SD.)						
SILT (SL.)						
CLAY (CL.)						
GRAIN SIZE	305 IN.	75 IN.	2.0	0.25	0.05	0.005

SOIL MOISTURE - CORRELATION OF TERMS

SOIL MOISTURE SCALE (ATTERBERG LIMITS)	FIELD MOISTURE DESCRIPTION	GUIDE FOR FIELD MOISTURE DESCRIPTION
LL - LIQUID LIMIT	- SATURATED - (SAT.)	USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE
PLASTIC RANGE (PI)	- WET - (W)	SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE
OM - OPTIMUM MOISTURE SHRINKAGE LIMIT	- MOIST - (M)	SOLID; AT OR NEAR OPTIMUM MOISTURE
SL - SHRINKAGE LIMIT	- DRY - (D)	REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE

PLASTICITY

NON PLASTIC	PLASTICITY INDEX (PI)	DRY STRENGTH
SLIGHTLY PLASTIC	0-5	VERY LOW
MODERATELY PLASTIC	6-15	SLIGHT
HIGHLY PLASTIC	16-25	MEDIUM
	26 OR MORE	HIGH

COLOR

DESCRIPTIONS MAY INCLUDE COLOR OR COLOR COMBINATIONS (TAN, RED, YELLOW-BROWN, BLUE-GRAY). MODIFIERS SUCH AS LIGHT, DARK, STREAKED, ETC. ARE USED TO DESCRIBE APPEARANCE.

GRADATION

WELL GRADED - INDICATES A GOOD REPRESENTATION OF PARTICLE SIZES FROM FINE TO COARSE.
 UNIFORMLY GRADED - INDICATES THAT SOIL PARTICLES ARE ALL APPROXIMATELY THE SAME SIZE.
 GAP-GRADED - INDICATES A MIXTURE OF UNIFORM PARTICLE SIZES OF TWO OR MORE SIZES.

ANGULARITY OF GRAINS

THE ANGULARITY OR ROUNDNESS OF SOIL GRAINS IS DESIGNATED BY THE TERMS: ANGULAR, SUBANGULAR, SUBROUNDED, OR ROUNDED.

MINERALOGICAL COMPOSITION

MINERAL NAMES SUCH AS QUARTZ, FELDSPAR, MICA, TALC, KAOLIN, ETC. ARE USED IN DESCRIPTIONS WHEN THEY ARE CONSIDERED OF SIGNIFICANCE.

COMPRESSIBILITY

SLIGHTLY COMPRESSIBLE	LL < 31
MODERATELY COMPRESSIBLE	LL = 31 - 50
HIGHLY COMPRESSIBLE	LL > 50

PERCENTAGE OF MATERIAL

ORGANIC MATERIAL	GRANULAR SOILS	SILT - CLAY SOILS	OTHER MATERIAL
TRACE OF ORGANIC MATTER	2 - 3%	3 - 5%	TRACE 1 - 10%
LITTLE ORGANIC MATTER	3 - 5%	5 - 12%	LITTLE 10 - 20%
MODERATELY ORGANIC	5 - 10%	12 - 20%	SOME 20 - 35%
HIGHLY ORGANIC	> 10%	> 20%	HIGHLY 35% AND ABOVE

GROUND WATER

WATER LEVEL IN BORE HOLE IMMEDIATELY AFTER DRILLING

STATIC WATER LEVEL AFTER 24 HOURS

PERCHED WATER, SATURATED ZONE, OR WATER BEARING STRATA

SPRING OR SEEP

MISCELLANEOUS SYMBOLS

RECOMMENDATION SYMBOLS

ABBREVIATIONS

AR - AUGER REFUSAL	MED. - MEDIUM	VST - VANE SHEAR TEST
BT - BORING TERMINATED	MICA - MICACEOUS	WEA. - WEATHERED
CL - CLAY	MOD. - MODERATELY	U - UNIT WEIGHT
CPT - CONE PENETRATION TEST	NP - NON PLASTIC	U _g - DRY UNIT WEIGHT
CSE - COARSE	ORG. - ORGANIC	
DMT - DILATOMETER TEST	PMT - PRESSUREMETER TEST	SAMPLE ABBREVIATIONS
DPT - DYNAMIC PENETRATION TEST	SAP. - SAPROLITIC	S - BULK
e - VOID RATIO	SD. - SAND, SANDY	SS - SPLIT SPOON
F - FINE	SL. - SILT, SILTY	ST - SHELBY TUBE
FOSS. - FOSSILIFEROUS	SLI. - SLIGHTLY	RS - ROCK
FRAC. - FRACTURED, FRACTURES	TCR - TRIAXIAL REFUSAL	RT - RECOMPACTED TRIAXIAL
FRAGS. - FRAGMENTS	w - MOISTURE CONTENT	CBR - CALIFORNIA BEARING RATIO
HI. - HIGHLY	V - VERY	

EQUIPMENT USED ON SUBJECT PROJECT

DRILL UNITS:	ADVANCING TOOLS:	HAMMER TYPE:
<input type="checkbox"/> CME-45C	<input type="checkbox"/> CLAY BITS	<input checked="" type="checkbox"/> AUTOMATIC <input type="checkbox"/> MANUAL
<input type="checkbox"/> CME-55	<input type="checkbox"/> 6" CONTINUOUS FLIGHT AUGER	
<input type="checkbox"/> CME-550	<input type="checkbox"/> 8" HOLLOW AUGERS	CORE SIZE:
<input type="checkbox"/> VANE SHEAR TEST	<input type="checkbox"/> HARD FACED FINGER BITS	<input type="checkbox"/> -B <input type="checkbox"/> -H
<input type="checkbox"/> PORTABLE HOIST	<input type="checkbox"/> TUNG-CARBIDE INSERTS	<input type="checkbox"/> -N
<input checked="" type="checkbox"/> CME-55 LC	<input checked="" type="checkbox"/> CASING <input type="checkbox"/> w/ ADVANCER	HAND TOOLS:
<input checked="" type="checkbox"/> CME-45 TRACK	<input checked="" type="checkbox"/> TRICONE 2 1/16" STEEL TEETH	<input type="checkbox"/> POST HOLE DIGGER
	<input type="checkbox"/> TRICONE " TUNG-CARB.	<input type="checkbox"/> HAND AUGER
	<input type="checkbox"/> CORE BIT	<input type="checkbox"/> SOUNDING ROD
	<input checked="" type="checkbox"/> 2 1/4" H.S.A.	<input type="checkbox"/> VANE SHEAR TEST

ROCK DESCRIPTION

HARD ROCK IS NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT REFUSAL IF TESTED. AN INFERRED ROCK LINE INDICATES THE LEVEL AT WHICH NON-COASTAL PLAIN MATERIAL WOULD YIELD SPT REFUSAL. SPT REFUSAL IS PENETRATION BY A SPLIT SPOON SAMPLER EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS IN NON-COASTAL PLAIN MATERIAL. THE TRANSITION BETWEEN SOIL AND ROCK IS OFTEN REPRESENTED BY A ZONE OF WEATHERED ROCK. ROCK MATERIALS ARE TYPICALLY DIVIDED AS FOLLOWS:

WEATHERED ROCK (WR)		NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT N VALUES > 100 BLOWS PER FOOT IF TESTED.
CRYSTALLINE ROCK (CR)		FINE TO COARSE GRAIN IGNEOUS AND METAMORPHIC ROCK THAT WOULD YIELD SPT REFUSAL IF TESTED. ROCK TYPE INCLUDES GRANITE, GNEISS, GABBRO, SCHIST, ETC.
NON-CRYSTALLINE ROCK (NCR)		FINE TO COARSE GRAIN METAMORPHIC AND NON-COASTAL PLAIN SEDIMENTARY ROCK THAT WOULD YIELD SPT REFUSAL IF TESTED. ROCK TYPE INCLUDES PHYLLITE, SLATE, SANDSTONE, ETC.
COASTAL PLAIN SEDIMENTARY ROCK (CP)		COASTAL PLAIN SEDIMENTS CEMENTED INTO ROCK, BUT MAY NOT YIELD SPT REFUSAL. ROCK TYPE INCLUDES LIMESTONE, SANDSTONE, CEMENTED SHELL BEDS, ETC.

WEATHERING

FRESH - ROCK FRESH, CRYSTALS BRIGHT, FEW JOINTS MAY SHOW SLIGHT STAINING. ROCK RINGS UNDER HAMMER IF CRYSTALLINE.

VERY SLIGHT (V SLI) - ROCK GENERALLY FRESH, JOINTS STAINED, SOME JOINTS MAY SHOW THIN CLAY COATINGS IF OPEN. CRYSTALS ON A BROKEN SPECIMEN FACE SHINE BRIGHTLY. ROCK RINGS UNDER HAMMER BLOWS IF OF A CRYSTALLINE NATURE.

SLIGHT (SLI) - ROCK GENERALLY FRESH, JOINTS STAINED AND DISCOLORATION EXTENDS INTO ROCK UP TO 1 INCH. OPEN JOINTS MAY CONTAIN CLAY. IN GRANITOID ROCKS SOME OCCASIONAL FELDSPAR CRYSTALS ARE DULL AND DISCOLORED. CRYSTALLINE ROCKS RING UNDER HAMMER BLOWS.

MODERATE (MOD) - SIGNIFICANT PORTIONS OF ROCK SHOW DISCOLORATION AND WEATHERING EFFECTS. IN GRANITOID ROCKS, MOST FELDSPARS ARE DULL AND DISCOLORED, SOME SHOW CLAY. ROCK HAS DULL SOUND UNDER HAMMER BLOWS AND SHOWS SIGNIFICANT LOSS OF STRENGTH AS COMPARED WITH FRESH ROCK.

MODERATELY SEVERE (MOD. SEV.) - ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. IN GRANITOID ROCKS, ALL FELDSPARS DULL AND DISCOLORED AND A MAJORITY SHOW KAOLINIZATION. ROCK SHOWS SEVERE LOSS OF STRENGTH AND CAN BE EXCAVATED WITH A GEOLOGIST'S PICK. ROCK GIVES "CLUNK" SOUND WHEN STRUCK. *IF TESTED, WOULD YIELD SPT REFUSAL*

SEVERE (SEV.) - ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC CLEAR AND EVIDENT BUT REDUCED IN STRENGTH TO STRONG SOIL. IN GRANITOID ROCKS ALL FELDSPARS ARE KAOLINIZED TO SOME EXTENT. SOME FRAGMENTS OF STRONG ROCK USUALLY REMAIN. *IF TESTED, WOULD YIELD SPT N VALUES > 100 BPF*

VERY SEVERE (V SEV.) - ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC ELEMENTS ARE DISCERNIBLE BUT MASS IS EFFECTIVELY REDUCED TO SOIL STATUS, WITH ONLY FRAGMENTS OF STRONG ROCK REMAINING. SAPROLITE IS AN EXAMPLE OF ROCK WEATHERED TO A DEGREE THAT ONLY MINOR VESTIGES OF ORIGINAL ROCK FABRIC REMAIN. *IF TESTED, WOULD YIELD SPT N VALUES < 100 BPF*

COMPLETE - ROCK REDUCED TO SOIL. ROCK FABRIC NOT DISCERNIBLE, OR DISCERNIBLE ONLY IN SMALL AND SCATTERED CONCENTRATIONS. QUARTZ MAY BE PRESENT AS DIKES OR STRINGERS. SAPROLITE IS ALSO AN EXAMPLE.

ROCK HARDNESS

VERY HARD - CANNOT BE SCRATCHED BY KNIFE OR SHARP PICK. BREAKING OF HAND SPECIMENS REQUIRES SEVERAL HARD BLOWS OF THE GEOLOGIST'S PICK.

HARD - CAN BE SCRATCHED BY KNIFE OR PICK ONLY WITH DIFFICULTY. HARD HAMMER BLOWS REQUIRED TO DETACH HAND SPECIMEN.

MODERATELY HARD - CAN BE SCRATCHED BY KNIFE OR PICK. GOUGES OR GROOVES TO 0.25 INCHES DEEP CAN BE EXCAVATED BY HARD BLOW OF A GEOLOGIST'S PICK. HAND SPECIMENS CAN BE DETACHED BY MODERATE BLOWS.

MEDIUM HARD - CAN BE GROUDED OR GOUGED 0.05 INCHES DEEP BY FIRM PRESSURE OF KNIFE OR PICK POINT. CAN BE EXCAVATED IN SMALL CHIPS TO PIECES 1 INCH MAXIMUM SIZE BY HARD BLOWS OF THE POINT OF A GEOLOGIST'S PICK.

SOFT - CAN BE GROUDED OR GOUGED READILY BY KNIFE OR PICK. CAN BE EXCAVATED IN FRAGMENTS FROM CHIPS TO SEVERAL INCHES IN SIZE BY MODERATE BLOWS OF A PICK POINT. SMALL, THIN PIECES CAN BE BROKEN BY FINGER PRESSURE.

VERY SOFT - CAN BE CARVED WITH KNIFE. CAN BE EXCAVATED READILY WITH POINT OF PICK. PIECES 1 INCH OR MORE IN THICKNESS CAN BE BROKEN BY FINGER PRESSURE. CAN BE SCRATCHED READILY BY FINGER NAIL.

FRACTURE SPACING		BEDDING	
TERM	SPACING	TERM	THICKNESS
VERY WIDE	MORE THAN 10 FEET	VERY THICKLY BEDDED	4 FEET
WIDE	3 TO 10 FEET	THICKLY BEDDED	1.5 - 4 FEET
MODERATELY CLOSE	1 TO 3 FEET	THINLY BEDDED	0.16 - 1.5 FEET
CLOSE	0.16 TO 1 FOOT	VERY THINLY BEDDED	0.03 - 0.16 FEET
VERY CLOSE	LESS THAN 0.16 FEET	THICKLY LAMINATED	0.008 - 0.03 FEET
		THINLY LAMINATED	< 0.008 FEET

INDURATION

FOR SEDIMENTARY ROCKS, INDURATION IS THE HARDENING OF MATERIAL BY CEMENTING, HEAT, PRESSURE, ETC.

FRIABLE - RUBBING WITH FINGER FREES NUMEROUS GRAINS; GENTLE BLOW BY HAMMER DISINTEGRATES SAMPLE.

MODERATELY INDURATED - GRAINS CAN BE SEPARATED FROM SAMPLE WITH STEEL PROBE; BREAKS EASILY WHEN HIT WITH HAMMER.

INDURATED - GRAINS ARE DIFFICULT TO SEPARATE WITH STEEL PROBE; DIFFICULT TO BREAK WITH HAMMER.

EXTREMELY INDURATED - SHARP HAMMER BLOWS REQUIRED TO BREAK SAMPLE; SAMPLE BREAKS ACROSS GRAINS.

TERMS AND DEFINITIONS

ALLUVIUM (ALLUV.) - SOILS THAT HAVE BEEN TRANSPORTED BY WATER.

AQUIFER - A WATER BEARING FORMATION OR STRATA.

ARENACEOUS - APPLIED TO ROCKS THAT HAVE BEEN DERIVED FROM SAND OR THAT CONTAIN SAND.

ARGILLACEOUS - APPLIED TO ALL ROCKS OR SUBSTANCES COMPOSED OF CLAY MINERALS, OR HAVING A NOTABLE PROPORTION OF CLAY IN THEIR COMPOSITION, SUCH AS SHALE, SLATE, ETC.

ARTESIAN - GROUND WATER THAT IS UNDER SUFFICIENT PRESSURE TO RISE ABOVE THE LEVEL AT WHICH IT IS ENCOUNTERED, BUT WHICH DOES NOT NECESSARILY RISE TO OR ABOVE THE GROUND SURFACE.

CALCAREOUS (CALC.) - SOILS THAT CONTAIN APPRECIABLE AMOUNTS OF CALCIUM CARBONATE.

COLLUVIUM - ROCK FRAGMENTS MIXED WITH SOIL DEPOSITED BY GRAVITY ON SLOPE OR AT BOTTOM OF SLOPE.

CORE RECOVERY (REC.) - TOTAL LENGTH OF ALL MATERIAL RECOVERED IN THE CORE BARREL DIVIDED BY TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE.

DIKE - A TABULAR BODY OF IGNEOUS ROCK THAT CUTS ACROSS THE STRUCTURE OF ADJACENT ROCKS OR CUTS MASSIVE ROCK.

DIP - THE ANGLE AT WHICH A STRATUM OR ANY PLANAR FEATURE IS INCLINED FROM THE HORIZONTAL.

DIP DIRECTION (DIP AZIMUTH) - THE DIRECTION OR BEARING OF THE HORIZONTAL TRACE OF THE LINE OF DIP, MEASURED CLOCKWISE FROM NORTH.

FAULT - A FRACTURE OR FRACTURE ZONE ALONG WHICH THERE HAS BEEN DISPLACEMENT OF THE SIDES RELATIVE TO ONE ANOTHER PARALLEL TO THE FRACTURE.

FISSILE - A PROPERTY OF SPLITTING ALONG CLOSELY SPACED PARALLEL PLANES.

FLOAT - ROCK FRAGMENTS ON SURFACE NEAR THEIR ORIGINAL POSITION AND DISLODGED FROM PARENT MATERIAL.

FLOOD PLAIN (FP) - LAND BORDERING A STREAM, BUILT OF SEDIMENTS DEPOSITED BY THE STREAM.

FORMATION (FM) - A MAPPABLE GEOLOGIC UNIT THAT CAN BE RECOGNIZED AND TRACED IN THE FIELD.

JOINT - FRACTURE IN ROCK ALONG WHICH NO APPRECIABLE MOVEMENT HAS OCCURRED.

LEDGE - A SHELF-LIKE RIDGE OR PROJECTION OF ROCK WHOSE THICKNESS IS SMALL COMPARED TO ITS LATERAL EXTENT.

LENS - A BODY OF SOIL OR ROCK THAT THINS OUT IN ONE OR MORE DIRECTIONS.

MOTTLED (MOT.) - IRREGULARLY MARKED WITH SPOTS OF DIFFERENT COLORS. MOTTLING IN SOILS USUALLY INDICATES POOR AERATION AND LACK OF GOOD DRAINAGE.

PERCHED WATER - WATER MAINTAINED ABOVE THE NORMAL GROUND WATER LEVEL BY THE PRESENCE OF AN INTERVENING IMPERVIOUS STRATUM.

RESIDUAL (RES.) SOIL - SOIL FORMED IN PLACE BY THE WEATHERING OF ROCK.

ROCK QUALITY DESIGNATION (ROD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE.

SAPROLITE (SAP.) - RESIDUAL SOIL THAT RETAINS THE RELIC STRUCTURE OR FABRIC OF THE PARENT ROCK.

SILL - AN INTRUSIVE BODY OF IGNEOUS ROCK OF APPROXIMATELY UNIFORM THICKNESS AND RELATIVELY THIN COMPARED WITH ITS LATERAL EXTENT, THAT HAS BEEN EMPLACED PARALLEL TO THE BEDDING OR SCHISTOSITY OF THE INTRUDED ROCKS.

SLICKENSIDE - POLISHED AND STRIATED SURFACE THAT RESULTS FROM FRICTION ALONG A FAULT OR SLIP PLANE.

STANDARD PENETRATION TEST (PENETRATION RESISTANCE) (SPT) - NUMBER OF BLOWS (N OR BPF) OF A 140 LB. HAMMER FALLING 30 INCHES REQUIRED TO PRODUCE A PENETRATION OF 1 FOOT INTO SOIL WITH A 2 INCH OUTSIDE DIAMETER SPLIT SPOON SAMPLER. SPT REFUSAL IS PENETRATION EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS.

STRATA CORE RECOVERY (SREC.) - TOTAL LENGTH OF STRATA MATERIAL RECOVERED DIVIDED BY TOTAL LENGTH OF STRATUM AND EXPRESSED AS A PERCENTAGE.

STRATA ROCK QUALITY DESIGNATION (SROD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS WITHIN A STRATUM EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF STRATA AND EXPRESSED AS A PERCENTAGE.


TOPSOIL (TS) - SURFACE SOILS USUALLY CONTAINING ORGANIC MATTER.

BENCH MARK: BL-2
 N 602434.90 E 2077112.05
 ELEVATION: 186.27 FEET

NOTES:
 FIAD - FILLED IN AFTER DRILLING

PROJECT REFERENCE NO. W-5206AG	SHEET NO. 4
RW SHEET NO.	
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER
PRELIMINARY PLANS DO NOT USE FOR CONSTRUCTION	

PLANS PREPARED BY:
PARSONS
 RALEIGH, NORTH CAROLINA, (919) 854-1345
 NC LICENSE NO. F-0246
 FOR NORTH CAROLINA DEPT. OF TRANSPORTATION


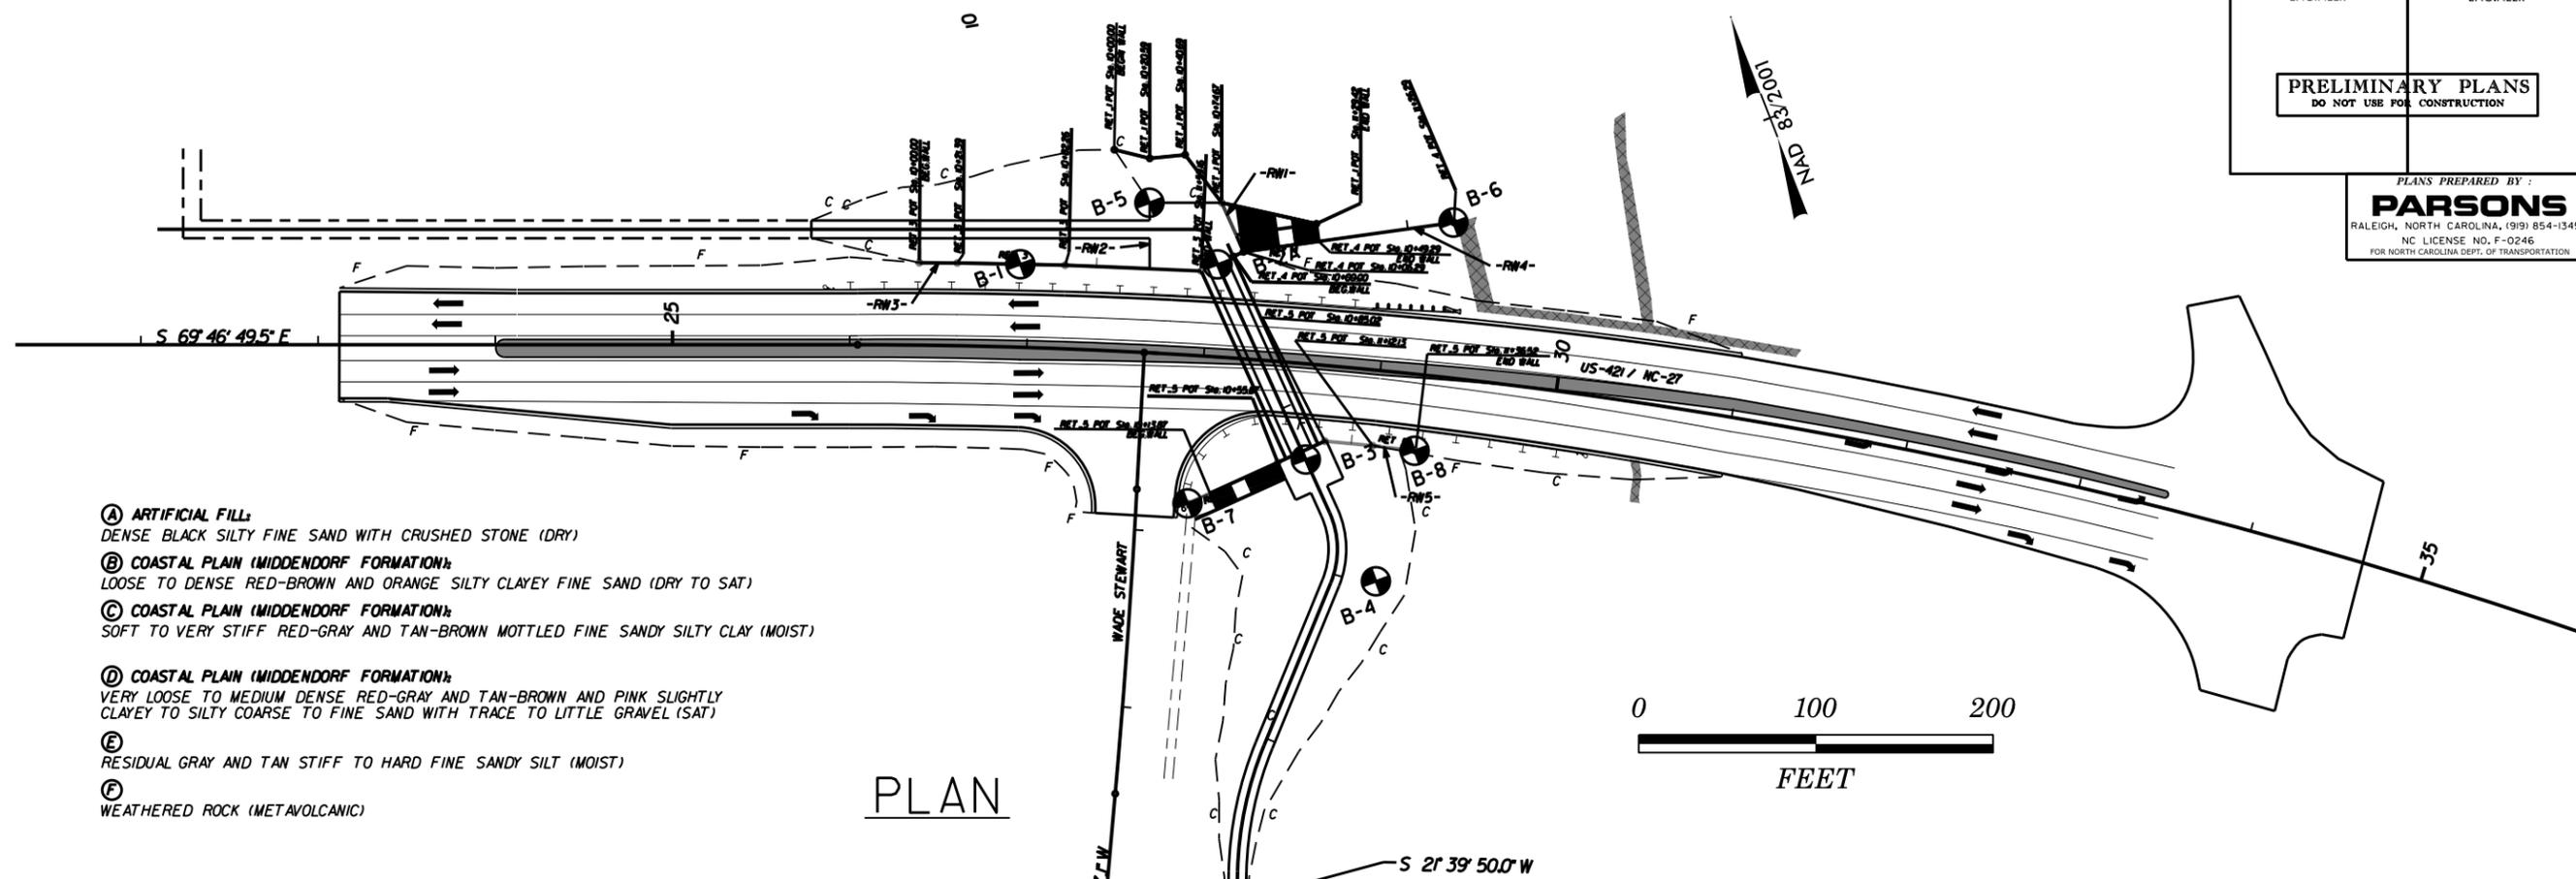


- (A) ARTIFICIAL FILL:**
DENSE BLACK SILTY FINE SAND WITH CRUSHED STONE (DRY)
- (B) COASTAL PLAIN (MIDDENDORF FORMATION):**
LOOSE TO DENSE RED-BROWN AND ORANGE SILTY CLAYEY FINE SAND (DRY TO SAT)
- (C) COASTAL PLAIN (MIDDENDORF FORMATION):**
SOFT TO VERY STIFF RED-GRAY AND TAN-BROWN MOTTLED FINE SANDY SILTY CLAY (MOIST)
- (D) COASTAL PLAIN (MIDDENDORF FORMATION):**
VERY LOOSE TO MEDIUM DENSE RED-GRAY AND TAN-BROWN AND PINK SLIGHTLY CLAYEY TO SILTY COARSE TO FINE SAND WITH TRACE TO LITTLE GRAVEL (SAT)
- (E)**
RESIDUAL GRAY AND TAN STIFF TO HARD FINE SANDY SILT (MOIST)
- (F)**
WEATHERED ROCK (METAVOLCANIC)

PLAN

NOTE: WALL ENVELOPE DOES NOT ACCURATELY DEPICT THE FACE OF THE WALL.

NOTE: INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORINGS WITH BOTH PROJECTED ON TO THE PROFILE. GROUND LINE TAKEN FROM RETAINING WALL PROFILE, DATED DECEMBER 2014.

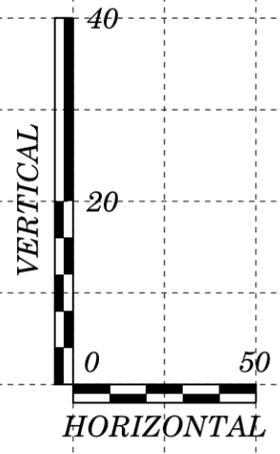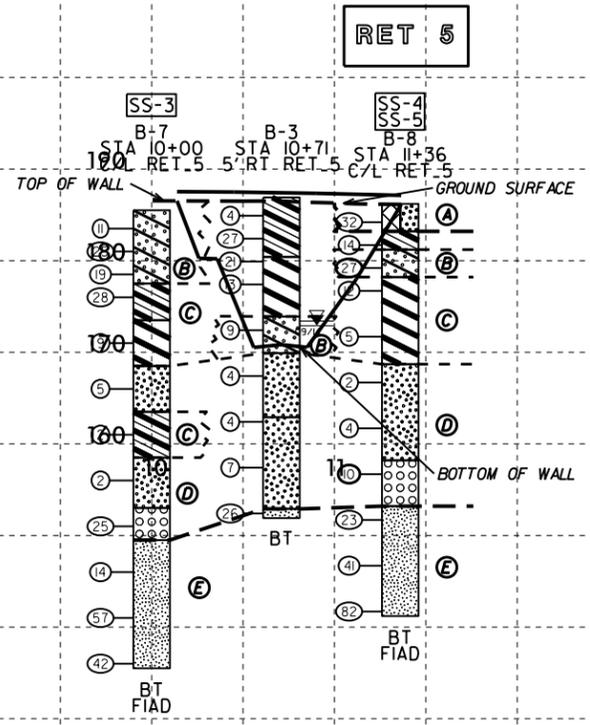

PROFILE

REVISIONS

16-DEC-2014 16:47
 C:\PROJECTS\2014\1305-14-078\CAD\W5206AG\CAMPBELL.UNIV.RETAININGWALL\CADD\GEO\TECH\Site&Sub\W5206AG_RdJ_PSH-4.dgn
 8/17/99

NCDOT GEOTECHNICAL ENGINEERING UNIT
BORELOG REPORT

WBS 45336.1.FR33		TIP W-5206AG		COUNTY HARNETT		GEOLOGIST Riggs, B.										
SITE DESCRIPTION Campbell University Pedestrian Tunnel Under 421/NC27							GROUND WTR (ft)									
BORING NO. B-1		STATION 10+57		OFFSET CL		ALIGNMENT RET_3										
COLLAR ELEV. 186.2 ft		TOTAL DEPTH 20.0 ft		NORTHING 602,567		EASTING 2,077,017										
DRILL RIG/HAMMER EFF./DATE SME0275 DIETRICH D-50 79% 11/25/2013		DRILL METHOD H.S. Augers		HAMMER TYPE Automatic												
DRILLER M. Moseley		START DATE 09/15/14		COMP. DATE 09/15/14		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
190																
185	185.2	1.0	3	3	5								M	GROUND SURFACE	0.0	
	182.7	3.5	7	10	14								D	COASTAL PLAIN Tan-Brown Fine Sandy Silty CLAY (MIDDENDORF FORMATION)	3.5	
180	180.2	6.0	6	8	10								D	Red-Brown and Gray Mottled Silty CLAY		
	177.7	8.5	4	5	7								D			
175	172.7	13.5	3	3	4								M			
170	167.7	18.5	1	1	1											
													Sat.	167.7 Pink Slightly Clayey Coarse to Fine SAND	18.5	
														166.2 Boring Terminated at Elevation 166.2 ft in Coastal Plain (MIDDENDORF FORMATION) Clayey SAND	20.0	

WBS 45336.1.FR33		TIP W-5206AG		COUNTY HARNETT		GEOLOGIST Riggs, B.										
SITE DESCRIPTION Campbell University Pedestrian Tunnel Under 421/NC27							GROUND WTR (ft)									
BORING NO. B-2A		STATION 16+11		OFFSET CL		ALIGNMENT CULVERT										
COLLAR ELEV. 187.1 ft		TOTAL DEPTH 44.9 ft		NORTHING 602,529		EASTING 2,077,121										
DRILL RIG/HAMMER EFF./DATE SME0275 DIETRICH D-50 79% 11/25/2013		DRILL METHOD H.S. Augers		HAMMER TYPE Automatic												
DRILLER M. Moseley		START DATE 09/15/14		COMP. DATE 09/15/14		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
190																
185	186.1	1.0	2	2	3								M	GROUND SURFACE	0.0	
	183.6	3.5	5	6	10								M	COASTAL PLAIN Brown and Red-Brown Fine Sandy CLAY (MIDDENDORF FORMATION)		
180	181.1	6.0	8	9	13								M	Red-Brown and Gray Mottled Silty CLAY	6.5	
	178.6	8.5	3	5	7								M			
175	173.6	13.5	2	3	3									Red and Tan Clayey Fine SAND	12.0	
170	168.6	18.5	2	1	2									White Silty Coarse to Fine SAND	18.6	
													Sat.			
165	163.6	23.5	1	1	1								Sat.	Pink Slightly Clayey Silty Fine SAND	23.5	
160	158.6	28.5	1	1	1								Sat.	Tan and Pink Clayey Fine SAND	28.0	
155	153.6	33.5	1	1	1								Sat.	Gray and Brown Fine Sandy SILT	32.0	
150	148.6	38.5	7	5	8								Sat.	RESIDUAL Gray and Brown Fine Sandy SILT	37.0	
145	143.6	43.5	16	30	60/0.4								M			
														142.6 WEATHERED ROCK (Metavolcanic)	44.5	
														142.2 Boring Terminated at Elevation 142.2 ft in Weathered Rock (Metavolcanic)	44.9	

NCDOT GEOTECHNICAL ENGINEERING UNIT
BORELOG REPORT

WBS 45336.1.FR33		TIP W-5206AG		COUNTY HARNETT		GEOLOGIST Riggs, B.										
SITE DESCRIPTION Campbell University Pedestrian Tunnel Under 421/NC27							GROUND WTR (ft)									
BORING NO. B-3		STATION 10+71		OFFSET 5 ft RT		ALIGNMENT RET_5										
COLLAR ELEV. 186.9 ft		TOTAL DEPTH 35.0 ft		NORTHING 602,408		EASTING 2,077,130										
DRILL RIG/HAMMER EFF./DATE SME0275 DIETRICH D-50 79% 11/25/2013			DRILL METHOD H.S. Augers		HAMMER TYPE Automatic											
DRILLER M. Moseley		START DATE 09/15/14		COMP. DATE 09/15/14		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100				ELEV. (ft)	DEPTH (ft)	
190															186.9	0.0
	185.9	1.0	1	1	3									M	GROUND SURFACE	
185	183.4	3.5	6	8	19									D	COASTAL PLAIN Brown and red-Brown Silty Fine Sandy CLAY (MIDDENDORF)	
	180.9	6.0	8	10	11									D	180.4	6.5
180	178.4	8.5	4	5	8									D	Red-Brown and Gray Mottled Silty CLAY	
	173.4	13.5	3	4	5									D	173.9	13.0
175	168.4	18.5	1	1	3									▼	Red and Tan Clayey Fine SAND	
	163.4	23.5	1	2	2									Sat.	169.9	17.0
165	158.4	28.5	4	2	5									Sat.	Pink Slightly Clayey Fine SAND	
	153.4	33.5	8	11	15									Sat.	162.9	24.0
160														Sat.	White and Tan Silty Fine to Coarse SAND	
															152.9	34.0
155														W	RESIDUAL Tan-Brown and Gray Fine Sandy SILT	
															151.9	35.0
															Boring Terminated at Elevation 151.9 ft in Residual Sandy SILT	

WBS 45336.1.FR33		TIP W-5206AG		COUNTY HARNETT		GEOLOGIST Riggs, B.										
SITE DESCRIPTION Campbell University Pedestrian Tunnel Under 421/NC27							GROUND WTR (ft)									
BORING NO. B-4		STATION 17+98		OFFSET 24 ft LT		ALIGNMENT CULVERT										
COLLAR ELEV. 186.8 ft		TOTAL DEPTH 20.0 ft		NORTHING 602,330		EASTING 2,077,143										
DRILL RIG/HAMMER EFF./DATE SME0275 DIETRICH D-50 79% 11/25/2013			DRILL METHOD H.S. Augers		HAMMER TYPE Automatic											
DRILLER M. Moseley		START DATE 09/15/14		COMP. DATE 09/15/14		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100				ELEV. (ft)	DEPTH (ft)	
190															186.8	0.0
	185.8	1.0	8	8	7									M	GROUND SURFACE	
185	183.3	3.5	5	8	13									D	COASTAL PLAIN Brown-Tan and Red-Brown Fine Sandy Silty CLAY (MIDDENDORF FORMATION)	
	180.8	6.0	8	10	17									D	180.3	6.5
180	178.3	8.5	8	16	22									D	Red-Tan and Gray Mottled Clayey Coarse to Fine SAND with Trace of Gravel	
	173.3	13.5	3	3	4									D	177.8	9.0
175	168.3	18.5	2	2	6									▼	Gray and Brown Clayey Fine SAND	
														Sat.	173.3	13.5
170														Sat.	Red-Gray and Brown Fine Sandy CLAY	
															167.8	19.0
															166.8	20.0
															Boring Terminated at Elevation 166.8 ft in Coastal Plain (MIDDENDORF FORMATION) Silty Fine SAND	



NCDOT GEOTECHNICAL ENGINEERING UNIT

BORELOG REPORT

WBS 45336.1.FR33		TIP W-5206AG		COUNTY HARNETT		GEOLOGIST Riggs, B.												
SITE DESCRIPTION Campbell University Pedestrian Tunnel Under 421/NC27							GROUND WTR (ft)											
BORING NO. B-5		STATION 10+50		OFFSET 32 ft RT		ALIGNMENT RET_1												
COLLAR ELEV. 188.6 ft		TOTAL DEPTH 49.0 ft		NORTHING 602,574		EASTING 2,077,097												
DRILL RIG/HAMMER EFF./DATE SME3193 CME-550X 89% 11/18/2013				DRILL METHOD Wash Boring		HAMMER TYPE Automatic												
DRILLER J. White		START DATE 11/20/14		COMP. DATE 11/20/14		SURFACE WATER DEPTH N/A												
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION				
			0.5ft	0.5ft	0.5ft	0	25	50	75	100				ELEV. (ft)	DEPTH (ft)			
190															188.6	0.0	GROUND SURFACE	
	187.6	1.0	7	6	6	12								D			COASTAL PLAIN	
	185.1	3.5	6	6	8	14								D			Red-Brown and Orange Silty Clayey Fine SAND (MIDDENDORF FORMATION)	
	182.6	6.0	7	7	11	18								D				
	180.1	8.5	5	8	10	18								SS-1	27%		Red Gray and Tan Mottled Fine Sandy Silty CLAY	
	175.1	13.5	3	3	5	3								M				
	170.1	18.5	2	1	2	3								Sat.			Red Gray and Tan Slightly Clayey Silty Fine SAND with Trace of Gravel	
	165.1	23.5	5	4	4	3								Sat.				
	160.1	28.5	1	1	1	2								Sat.				
	155.1	33.5	1	1	1	2								Sat.				
	150.1	38.5	60/0.4			60/0.4								Sat.			WEATHERED ROCK (Metavolcanic)	
	145.1	43.5	60/0.3			60/0.3								Sat.				
	140.1	48.5	60/0.4			60/0.4								Sat.				
																		Boring Terminated at Elevation 139.6 ft in Weathered Rock (Metavolcanic)

WBS 45336.1.FR33		TIP W-5206AG		COUNTY HARNETT		GEOLOGIST Riggs, B.												
SITE DESCRIPTION Campbell University Pedestrian Tunnel Under 421/NC27							GROUND WTR (ft)											
BORING NO. B-6		STATION 11+26		OFFSET CL		ALIGNMENT RET_4												
COLLAR ELEV. 188.2 ft		TOTAL DEPTH 50.0 ft		NORTHING 602,504		EASTING 2,077,255												
DRILL RIG/HAMMER EFF./DATE SME3193 CME-550X 89% 11/18/2013				DRILL METHOD Wash Boring		HAMMER TYPE Automatic												
DRILLER J. White		START DATE 11/20/14		COMP. DATE 11/20/14		SURFACE WATER DEPTH N/A												
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION				
			0.5ft	0.5ft	0.5ft	0	25	50	75	100				ELEV. (ft)	DEPTH (ft)			
190															188.2	0.0	GROUND SURFACE	
	187.2	1.0	2	1	3	4								M			COASTAL PLAIN	
	184.7	3.5	5	6	8	14								SS-2	22%		Red-Brown and Orange Fine to Coarse Sandy Silty CLAY (MIDDENDORF FORMATION)	
	182.2	6.0	7	12	11	23								M			Red-Gray and Tan Silty Clayey Fine SAND with Trace of Gravel	
	179.7	8.5	7	10	15	25								M			Gray and Tan Fine Sandy Silty CLAY	
	174.7	13.5	18	17	9	26								W			Red and Pink Clayey Coarse to Fine SAND with Trace of Gravel	
	169.7	18.5	2	8	11	19								Sat.				
	164.7	23.5	1	2	1	3								Sat.			Pink and Tan Silty Fine SAND	
	159.7	28.5	1	2	2	4								Sat.				
	154.7	33.5	3	8	4	12								Sat.			Brown and Tan Silty Fine SAND	
	149.7	38.5	7	11	12	23								Sat.				
	144.7	43.5	12	17	21	38								M			RESIDUAL Gray and Brown Fine Sandy SILT	
	139.7	48.5	35	26	32	58								M				
																		Boring Terminated at Elevation 138.2 ft in Residual Sandy SILT

NCDOT BORE DOUBLE 14-078.GPJ NC_DOT_GDT 12/17/14

